
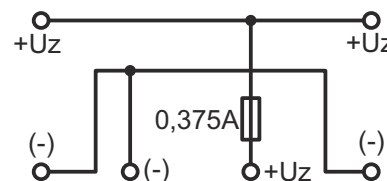
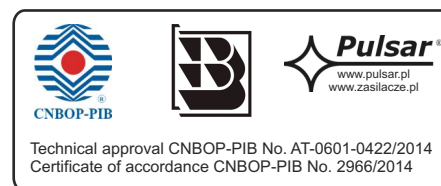
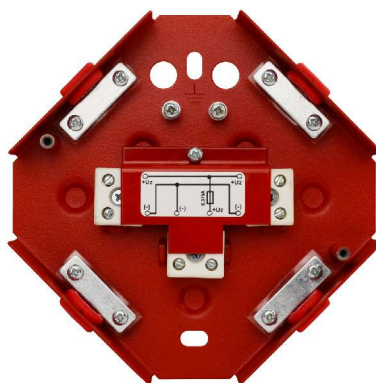


CODE: **AWOZ-125S** v.1.0/III  
 NAME: **Distribution Junction Box with 0,375A fuse**

EN\*\*

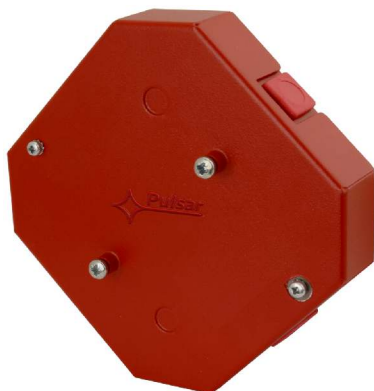

## DESCRIPTION

The junction box for fire alarm systems is designed for connecting fire protection devices in cable installation systems with fire resistance according to the DIN 4102-12 standard, where the uninterruptible power supply or transmission of the signal in case of fire is required.

The junction box is designed to guarantee the mechanical ability to keep the cable routes capable of guaranteeing the uninterruptible power supply and transmission of telecommunication signals in the fire zone.

The junction box can be used for power supply of fire protection equipment, such as ventilators and smoke vents, fire alarm control panels, emergency warning systems, etc.

The junction box is fitted with separate terminals for connecting the signal line input, signal line output and the indicator or another device via the fuse. The enclosure is equipped with mounting sleeves to mount the optical - acoustic indicator.

TECHNICAL PARAMETERS	
<b>Voltage</b>	125V AC max
<b>Output current</b>	0,375 A
<b>Diameter of installation cable</b>	Max. 10mm
<b>Cross-section of the cable</b>	Max. 2,5mm <sup>2</sup>
<b>Protection class</b>	IP20
<b>Enclosure</b>	DC01 1mm steel plate, color RAL 3001 (red)
<b>Dimensions</b>	120 x 120 x 37 [mm] (WxHxD)
<b>Mounting</b>	100mm $\Phi$ 5,5 mm
<b>Net/gross weight</b>	0,43kg /0,47kg
<b>Certificates, declarations, warranty</b>	Technical approval CNBOP-PIB No. AT-0601-0422/2014 Certificate of accordance CNBOP-PIB No. 2966/2014 RoHS, 3 year from the production date